

1992 EDITORIAL INDEX

Technical articles by author and subject

AUTHOR

Acevedo-Ruiz, M.

Using infrared thermography to study building heat transfer; with D. K. Arasteh, F.A. Beck, B.T. Griffin and N. Byars; *October p.34*

Advani, Atma

Alternate refrigerants and energy savings in supermarkets; *December p.40*

Albern, William F.

1992 HVAC&R Technology Review, Part I, Innovations in the HVAC&R industry; *January p.46*

Arasteh, D.K.

Using infrared thermography to study building heat transfer; with F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

Arceneaux, Thomas W.

Retrofitting the heating system for NASA's Space Shuttle engine test facility; *July p.24*

Atwood, Theodore

1992 HVAC&R Technology Review, Part I, Cooling cycle technologies; *January p.51*

Azer, Naim Z.

1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; *February p.47*

Bankston, Charles A.

Central solar heating plants with seasonal storage; with Dwayne S. Bregger and J. Edward Sunderland; *May p.27*

Barnett, Richard C.

Consultants' options on CFCs and alternative refrigerants, The CFC phase-out: Issues and problems; *February p.34*

Bathgate, Thomas A.

1992 HVAC&R Technology Review, Part I, Integrating HVAC and architecture; *January p.46*

Beck, F.A.

Using infrared thermography to study building heat transfer; with D.K. Arasteh, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

Bergles, Arthur E.

1992 HVAC&R Technology Review, Part II, Second generation heat transfer technology; *February p.48*

Berglund, M. Birgitta

1992 HVAC&R Technology Review, Part II, Indoor air quality and ventilation; *February p.47*

Bevirt, W. David

1992 HVAC&R Technology Review, Part I, Solving indoor environmental problems; *January p.48*

Calculating for system effect solves fan capacity losses; *November p.46*

Biederman, Richard

Status of the HVAC industry; with Jaroslav Wurm; *January p.523*

Blades, Russell W.

Modernizing and retrofitting ice skating rinks; *April p.34*

Bradley, B.C.

Freeze-control strategy and air-to-air energy recovery performance; with E. G. Phillips, D.R. Fisher and R.E. Chant; *December p.44*

Brager, Gail S.

Using laboratory-based models to predict comfort in office buildings; *April p.44*

Brant, Douglas M.

1992 Technology Awards, HVAC System combines constant air motion and thermal storage; *March p.21*

Bregger, Dwayne S.

Central solar heating plants with seasonal storage; with Charles A. Bankston and J. Edward Sunderland; *May p.27*

Broughton, Dale R.

An analysis of an evaporative water chiller; with Richard G. Supple; *June p.44*

Brown, Will K.

Evaporative cooling for a laboratory facility; *September p.60*

Brunner, Chester A.

Optimizing water-loop heat pump design and performance; with Edward A. Kush; *February p.14*

Bryant, Kathy

Environmental considerations for cooling towers; with Gary R. Mirsky and Jean-Pierre Liebert; *June p.27*

Buckley, Norman A.

1992 HVAC&R Technology Review, Part I, Radiant heating technology; *January p.49*

Burgett, Lee W.

Consultants' options on CFCs and alternative refrigerants, *ASHRAE Standard 15* and *Standard 34*: Current and future with new alternative refrigerants; *February p.44*

Butler, David S., Sr.

1992 HVAC&R Technology Review, Part II, Perceptions of the HVAC&R industry; *February p.50*

Byars, N.

Using infrared thermography to study building heat transfer; with D.K. Arasteh, F.A. Beck, B.T. Griffin and M. Acevedo-Ruiz; *October p.34*

Calm, James M.

Consultants' options on CFCs and alternative refrigerants, Equipment for alternative refrigerants; *February p.40*

Calton, Dean

Distributed air conditioning in supermarkets; *May p.40*

Chant, R.E.

Freeze-control strategy and air-to-air energy recovery performance; with E. G. Phillips, D.R. Fisher and B.C. Bradley; *December p.44*

Charles, Richard A.

1992 HVAC&R Technology Review, Part II, Experience and technical insights in the HVAC&R industry; *February p.48*

Sharing resources globally; *August p.20*

Collett, Christopher W.

Commissioning to avoid indoor air quality problems; with Elia M. Sterling, Simon Turner and Christopher C. Downing; *October p.28*

Davison, Fred G.

Direct digital control documentation employing graphical programming; *September p.46*

DeLoache, William A.

Providing a healthy environment at the Marine Mammal Pavilion; *May p.48*

Den Braven, Karen R.

A ground-coupled storage heat pump system with waste heat recovery; with David C. Drown and Timothy P. Kast; *February p.20*

Dirkes, James V., II

Duct protection for variable speed fans; *November p.40*

Downing, Christopher C.

Commissioning to avoid indoor air quality problems; with Elia M. Sterling, Christopher W. Collett and Simon Turner; *October p.28*

Drees, Kirk H.

Ventilation airflow measurement for *ASHRAE Standard 62-1989*; with Jarrell D. Wenger and George Janu; *October p.40*

Drown, David C.

A ground-coupled storage heat pump system with waste heat recovery; with Timothy P. Kast and Karen R. Den Braven; *February p.20*

Dussault, Richard E.

1992 HVAC&R Technology Review, Part I, The challenge is us; *January p.53*

Epstein, Gary J.

Environmental tradeoffs between CFCs and alternative refrigerants; with Steven P. Manwell; *January p.38*

1992 EDITORIAL INDEX

Technical articles by author and subject

AUTHOR

Acevedo-Ruiz, M.

Using infrared thermography to study building heat transfer; with D. K. Arasteh, F.A. Beck, B.T. Griffin and N. Byars; *October p.34*

Advani, Atma

Alternate refrigerants and energy savings in supermarkets; *December p.40*

Albern, William F.

1992 HVAC&R Technology Review, Part I, Innovations in the HVAC&R industry; *January p.46*

Arasteh, D.K.

Using infrared thermography to study building heat transfer; with F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

Arceneaux, Thomas W.

Retrofitting the heating system for NASA's Space Shuttle engine test facility; *July p.24*

Atwood, Theodore

1992 HVAC&R Technology Review, Part I, Cooling cycle technologies; *January p.51*

Azer, Naim Z.

1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; *February p.47*

Bankston, Charles A.

Central solar heating plants with seasonal storage; with Dwayne S. Bregger and J. Edward Sunderland; *May p.27*

Barnett, Richard C.

Consultants' options on CFCs and alternative refrigerants, The CFC phase-out: Issues and problems; *February p.34*

Bathgate, Thomas A.

1992 HVAC&R Technology Review, Part I, Integrating HVAC and architecture; *January p.46*

Beck, F.A.

Using infrared thermography to study building heat transfer; with D.K. Arasteh, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

Bergles, Arthur E.

1992 HVAC&R Technology Review, Part II, Second generation heat transfer technology; *February p.48*

Berglund, M. Birgitta

1992 HVAC&R Technology Review, Part II, Indoor air quality and ventilation; *February p.47*

Bevirt, W. David

1992 HVAC&R Technology Review, Part I, Solving indoor environmental problems; *January p.48*

Calculating for system effect solves fan capacity losses; *November p.46*

Biederman, Richard

Status of the HVAC industry; with Jaroslav Wurm; *January p.523*

Blades, Russell W.

Modernizing and retrofitting ice skating rinks; *April p.34*

Bradley, B.C.

Freeze-control strategy and air-to-air energy recovery performance; with E. G. Phillips, D.R. Fisher and R.E. Chant; *December p.44*

Brager, Gail S.

Using laboratory-based models to predict comfort in office buildings; *April p.44*

Brant, Douglas M.

1992 Technology Awards, HVAC System combines constant air motion and thermal storage; *March p.21*

Bregger, Dwayne S.

Central solar heating plants with seasonal storage; with Charles A. Bankston and J. Edward Sunderland; *May p.27*

Broughton, Dale R.

An analysis of an evaporative water chiller; with Richard G. Supple; *June p.44*

Brown, Will K.

Evaporative cooling for a laboratory facility; *September p.60*

Brunner, Chester A.

Optimizing water-loop heat pump design and performance; with Edward A. Kush; *February p.14*

Bryant, Kathy

Environmental considerations for cooling towers; with Gary R. Mirsky and Jean-Pierre Liebert; *June p.27*

Buckley, Norman A.

1992 HVAC&R Technology Review, Part I, Radiant heating technology; *January p.49*

Burgett, Lee W.

Consultants' options on CFCs and alternative refrigerants, *ASHRAE Standard 15* and *Standard 34*: Current and future with new alternative refrigerants; *February p.44*

Butler, David S., Sr.

1992 HVAC&R Technology Review, Part II, Perceptions of the HVAC&R industry; *February p.50*

Byars, N.

Using infrared thermography to study building heat transfer; with D.K. Arasteh, F.A. Beck, B.T. Griffin and M. Acevedo-Ruiz; *October p.34*

Calm, James M.

Consultants' options on CFCs and alternative refrigerants, Equipment for alternative refrigerants; *February p.40*

Calton, Dean

Distributed air conditioning in supermarkets; *May p.40*

Chant, R.E.

Freeze-control strategy and air-to-air energy recovery performance; with E. G. Phillips, D.R. Fisher and B.C. Bradley; *December p.44*

Charles, Richard A.

1992 HVAC&R Technology Review, Part II, Experience and technical insights in the HVAC&R industry; *February p.48*

Sharing resources globally; *August p.20*

Collett, Christopher W.

Commissioning to avoid indoor air quality problems; with Elia M. Sterling, Simon Turner and Christopher C. Downing; *October p.28*

Davison, Fred G.

Direct digital control documentation employing graphical programming; *September p.46*

DeLoache, William A.

Providing a healthy environment at the Marine Mammal Pavilion; *May p.48*

Den Braven, Karen R.

A ground-coupled storage heat pump system with waste heat recovery; with David C. Drown and Timothy P. Kast; *February p.20*

Dirkes, James V., II

Duct protection for variable speed fans; *November p.40*

Downing, Christopher C.

Commissioning to avoid indoor air quality problems; with Elia M. Sterling, Christopher W. Collett and Simon Turner; *October p.28*

Drees, Kirk H.

Ventilation airflow measurement for *ASHRAE Standard 62-1989*; with Jarrell D. Wenger and George Janu; *October p.40*

Drown, David C.

A ground-coupled storage heat pump system with waste heat recovery; with Timothy P. Kast and Karen R. Den Braven; *February p.20*

Dussault, Richard E.

1992 HVAC&R Technology Review, Part I, The challenge is us; *January p.53*

Epstein, Gary J.

Environmental tradeoffs between CFCs and alternative refrigerants; with Steven P. Manwell; *January p.38*

Ertinger, Richard

Consultants' options on CFCs and alternative refrigerants; Retrofitting centrifugal chillers for alternative refrigerants; *February p.38*

Fairchild, Phillip D.

Global warming implications of replacing CFCs; with Steven K. Fischer and Patrick J. Hughes; *April p.14*

Fettkether, Larry M.

1992 Technology Awards, Geothermal system meets space heating requirements; *March p.43*

Fischer, Steven K.

Global warming implications of replacing CFCs; with Phillip D. Fairchild and Patrick J. Hughes; *April p.14*

Fisher, D.R.

Freeze-control strategy and air-to-air energy recovery performance; with E.G. Phillips, R.E. Chant and B.C. Bradley; *December p.44*

Garrett, Fred T., Jr.

1992 HVAC&R Technology Review, Part II, HVAC&R and DCS; *February p.51*

Garrett, Steven L.

Thermoacoustic refrigeration; with Thomas J. Hofler; *December p.28*

Grant, John

Consultants' options on CFCs and alternative refrigerants; CFC reclaim and disposal; *February p.43*

Griffin, B.T.

Using infrared thermography to study building heat transfer; with D.K. Arasteh, F.A. Beck, N. Byars and M. Acevedo-Ruiz; *October p.34*

Guntermann, Alfred E.

1992 HVAC&R Technology Review, Part II, A state of pause...; *February p.49*

Hasegawa, Toshio

Air-conditioning systems of the KI Building; with Akira Okamoto and Satoshi Togari; *August p.33*

Hess, Catherine A.

Doctors, lawyers and building-associated diseases; with Michael J. Hodgson; *February p.25*

Hill, James E.

Consultants' options on CFCs and alternative refrigerants; Introduction; *February p.34*

1992 HVAC&R Technology Review, Part II, Technical innovations of the future; *February p.52*

Hodgson, Michael J.

Doctors, lawyers and building-associated diseases; with Catherine A. Hess; *February p.25*

Hofler, Thomas J.

Thermoacoustic refrigeration; with Steven L. Garrett; *December p.28*

Holness, Gordon V.R.

Combined chilled water thermal energy storage and fire protection systems; *May p.16*

Howell, Ronald H.

Estimating the indoor air quality and energy performance of VAV systems; with Harry J. Sauer Jr.; *July p.43*

Hufford, Paul E.

Absorption chillers improve cogeneration efficiency; *March p.46*

Huggins, Donald R.

1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; with William E. Tinsley and Bryce Swindler; *March p.24*

Hughes, Patrick J.

Global warming implications of replacing CFCs; with Steven K. Fischer and Phillip D. Fairchild; *April p.14*

Int-Hout, Daniel


Low temperature air, thermal comfort and indoor air quality; *May p.34*

Janssen, John E.

Working with ANSI/ASHRAE Standard 62-1989; *August p.23*

Mid-West[®] Instrument

"FILTER-MINDER" Differential Pressure Gauges

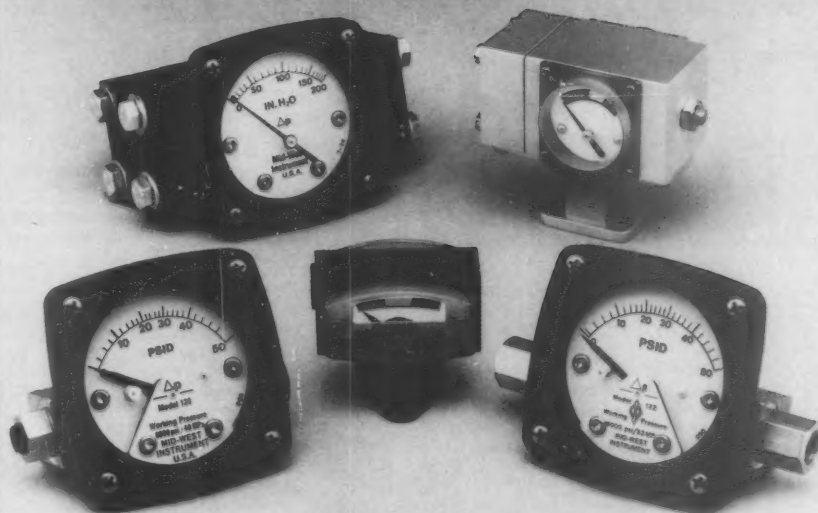

■ Low cost reliable differential pressure gauges for use in measuring pressure drop across filters, strainers, separators.

■ More cost effective and more accurate than using two pressure gauges in monitoring filter performance. All gauges can be private branded.

■ Aluminum or 316 stainless steel housing with 316 stainless steel internals with a variety of connections/ mountings optionally available.

6500 DOBRY DR. ■ STERLING HEIGHTS, MI 48314 U.S.A. ■ (313) 254-6500 ■ 1-800-648-5778 ■ FAX (313) 254-6509

(Circle No. 84 on Reader Service Card)

Janu, George

Ventilation airflow measurement for *ASHRAE Standard 62-1989*; with Kirk H. Drees and Jarrell D. Wenger; *October p.40*

Kast, Timothy P.

A ground-coupled storage heat pump system with waste heat recovery; with David C. Drown and Karen R. Den Braven; *February p.20*

Kato, Akira

HVAC systems for Sakuya Konohanakan; with Kazuhiro Otaka; *August p.37*

Kavanaugh, Steve

Ground-coupled heat pumps for commercial buildings; *September p.30*

Kelso, Richard M.

1992 HVAC&R Technology Review, Part II, Trends in environmental controls; *February p.46*

Kern, J.D.

1992 HVAC&R Technology Review, Part II, Technology and the HVAC designer; *February p.52*

Kirol, Lance D.

Solid-gas chemisorption: Efficient HVAC&R without CFCs; with Uwe Rockenfeller and William A. Ryan; *March p.54*

Klote, John H.

A preview of ASHRAE's revised smoke control manual; *November p.34*

Kosonen, Risto

Cool ceiling system: A European air-conditioning alternative; with Christopher K. Wilkins; *August p.41*

Kush, Edward A.

Optimizing water-loop heat pump design and performance; with Chester A. Brunner; *February p.14*

Levenhagen, John I.

Control systems to comply with *ASHRAE Standard 62-1989*; *September p.40*

Liebert, Jean-Pierre

Environmental considerations for cooling towers; with Gary R. Mirsky and Kathy Bryant; *June p.27*

Loiselle, Steven A.

Performance of air cleaners in a residential forced air system; with Francis J. Offermann and Richard G. Sextro; *July p.51*

Lotz, William A.

1992 HVAC&R Technology Review, Part II, ASHRAE—New technologies; *February p.48*

McFall, James D.

1992 HVAC&R Technology Review, Part II, Invited opinions about the future; *February p.46*

Manning, Billy R.

Consultants' options on CFCs and alternative refrigerants, Building code recognition of alternative refrigerants; *February p.36*

Manwell, Steven P.

Environmental tradeoffs between CFCs and alternative refrigerants; with Gary J. Epstein; *January p.38*

Marchant, Roger

Sandwich pressurization systems for smoke control; *November p.20*

Mirsky, Gary R.

Environmental considerations for cooling towers; with Jean-Pierre Liebert and Kathy Bryant; *June p.27*

Mumma, Stanley A.

1992 HVAC&R Technology Review, Part I, Education and innovation; *January p.49*

Nagengast, Bernard A.

The first 80 years of air conditioning; *January p.5164*

Niess, Richard C.

1992 HVAC&R Technology Review, Part II, ASHRAE and the future; *February p.49*

Offermann, Francis J.

Performance of air cleaners in a residential forced air system; with Steven A. Loiselle and Richard G. Sextro; *July p.51*

Okamoto, Akira

Air-conditioning systems of the KI Building; with Toshio Hasegawa and Satoshi Togari; *August p.33*

Ostrander, William S.

Consultants' options on CFCs and alternative refrigerants, Selecting equipment and refrigerants in uncertain times; *February p.42*

Otaka, Kazuhiro

HVAC systems for Sakuya Konohanakan; with Akira Kato; *August p.37*

Parikh, J.S.

Testing and certification of fire and smoke dampers; *November p.30*

Perlman, Maier

1992 HVAC&R Technology Review, Part I, Electric utility R&D; *January p.51*

Phillips, E.G.

Freeze-control strategy and air-to-air energy recovery performance; with D.R. Fisher, R.E. Chant and B.C. Bradley; *December p.44*

Pienta, William T.

Integrating building automation and control; *September p.54*

Procell, Charles J.

1992 HVAC&R Technology Review, Part II, Technical information exchange; *February p.47*

Rafferty, Kevin

Geothermal district heating: A century of service; *September p.22*

Reistad, Gordon M.

1992 HVAC&R Technology Review, Part II, Microelectronics, energy and the environment; *February p.51*

Richard, Robert G.

Flammability of alternative refrigerants; with Ian R. Shankland; *April p.20*

Rockenfeller, Uwe

Solid-gas chemisorption: Efficient HVAC&R without CFCs; with Lance D. Kirol and William A. Ryan; *March p.54*

Romine, Thomas B., Jr.

Cooling load calculation: Art or science?; *January p.14*

Rose, Susan L.

Emerging legal concerns in indoor air quality; *February p.25*

Roth, Robert J.

Consultants' options on CFCs and alternative refrigerants, The impact of EPA's new CFC/HFC regulations; *February p.35*

Rowland, F. Sherwood

The CFC controversy: Issues and answers; *December p.20*

Ryan, William A.

Solid-gas chemisorption: Efficient HVAC&R without CFCs; with Uwe Rockenfeller and Lance D. Kirol; *March p.54*

Sauer, Harry J., Jr.

Estimating the indoor air quality and energy performance of VAV systems; with Ronald H. Howell; *July p.43*

Scofield, C. Mike

Dry climate evaporative cooling with refrigeration backup; with Elia M. Sterling; *June p.49*

Sextro, Richard G.

Performance of air cleaners in a residential forced air system; with Francis J. Offermann and Steven A. Loiselle; *July p.51*

Shankland, Ian R.

Flammability of alternative refrigerants; with Robert G. Richard; *April p.20*

Shute, Robert W.

Integrating access floor plenums for HVAC air distribution; *October p.46*

Snyder, Gerald C.

Renovating the Pentagon's heating and refrigeration plant; *July p.28*

Stanzani, Franco

1992 HVAC&R Technology Review, Part II, HVAC industry at a critical state; *February p.49*

Sterling, Elia M.

Dry climate evaporative cooling with refrigeration backup; with C. Mike Scofield; *June p.49*

Commissioning to avoid indoor air quality problems; with Christopher W. Collett, Simon Turner and Christopher C. Downing; *October p.28*

Stewart, Steven M.

Reaching agreements on indoor air quality; *August p.28*

Stotz, Robert B.

1992 Technology Awards, School HVAC renovation provides energy savings; *March p.30*

Sunderland, J. Edward

Central solar heating plants with seasonal storage; with Dwayne S. Breger and Charles A. Bankston; *May p.27*

Supple, Richard G.

An analysis of an evaporative water chiller; with Dale R. Broughton; *June p.44*

Swindler, Bryce

1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; with William E. Tinsley and Donald R. Huggins; *March p.24*

Tamblyn, B.T.

Commissioning: An operation and maintenance perspective; *October p.22*

Tinsley, William E.

1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; with Bryce Swindler and Donald R. Huggins; *March p.24*

Togari, Satoshi

Air-conditioning systems of the KI Building; with Akira Okamoto and Toshio Hasegawa; *August p.33*

Turaga, Mal

1992 HVAC&R Technology Review, Part I, Ensuring safe and healthy buildings; *January p.50*

Turner, Simon

Commissioning to avoid indoor air quality problems; with Elia M. Sterling, Christopher W. Collett and Christopher C. Downing; *October p.28*

Ventresca, Joseph A.

Economizer operation and maintenance for indoor air quality; *January p.26*

Watt, John R.

1992 HVAC&R Technology Review, Part II, Tomorrow's cooling challenges; *February p.50*

Cooling our tomorrows economically; *June p.36*

Wenger, Jarrell D.

Ventilation airflow measurement for ASHRAE Standard 62-1989; with Kirk H. Drees and George Janu; *October p.40*

Wessel, Dennis J.

Air-conditioning system retrofit for an historic office building; *July p.38*

Wheeler, Arthur E.

Energy conservation and acceptable indoor air quality; *April p.26*

Wilkins, Christopher K.

Cool ceiling system: A European air-conditioning alternative; with Risto Kosonen; *August p.41*

Williams, Gerald J.

1992 Technology Awards, Air handling system retrofit reduces energy consumption; *March p.34*

Witte, Mark O.

1992 Technology Awards, Filtration system solves airborne oil mist problem; *March p.40*

Woods, James E.

1992 HVAC&R Technology Review, Part II, Providing for the health, comfort and welfare of the general public; *February p.51*

Wurm, Jaroslav

Status of the HVAC industry; with Richard Biederman; *January p.523*

Zhang, Z. John

Keep your cooling tower?; *June p.22*

SUBJECT

Absorption

Absorption chillers improve cogeneration efficiency; Paul E. Hufford; *March p.46*

Keep your cooling tower?; Z. John Zhang; *June p.22*

Air cleaning

Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loisel and Richard G. Sextro; *July p.51*

Air cooling


Absorption chillers improve cogeneration efficiency; Paul E. Hufford; *March p.46*

Combined chilled water thermal energy storage and fire protection storage systems; Gordon V.R. Holness; *May p.16*

Cooling our tomorrows economically; John R. Watt; *June p.36*

An analysis of an evaporative water chiller; Richard G. Supple and Dale R. Broughton; *June p.44*

Dry climate evaporative cooling with refrigeration backup; C. Mike Scofield and Elia M. Sterling; *June p.49*

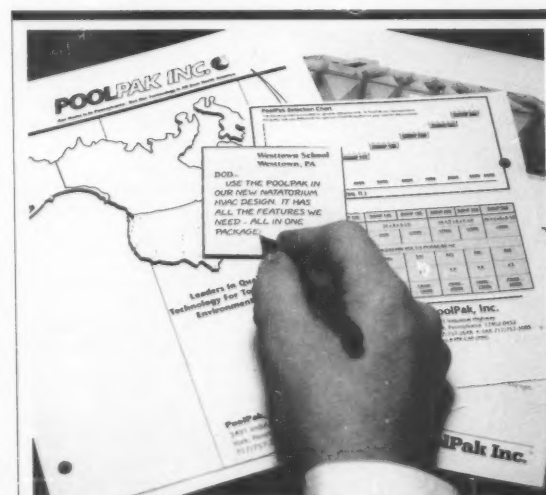

POOLPAK INC.
USE THE POOLPAK IN OUR NEW PATENTED HUMID DESIGN. IT HAS ALL THE FEATURES WE NEED - ALL IN ONE PACKAGE.
Leaders in Quality Technology for Total Indoor Pool Environmental Control
PoolPak, Inc.
1341 Industrial Highway • York, Pennsylvania 17402-0452
(717) 757-2648 • FAX (717) 757-5058

PoolPak offers the Complete Package —Automatic Control of Humidity, Air and Water Temperature, Ventilation and Full Economizer. Plus the Highest Energy Efficiency and Minimal Installed Costs. No other system comes close!

POOLPAK INC.

*The Leader In Quality And Technology For
Total Indoor Pool Environmental Control*

3491 Industrial Highway • York, Pennsylvania 17402-0452
(717) 757-2648 • FAX (717) 757-5058

(Circle No. 85 on Reader Service Card)

ASHRAE Journal December 1992



Pocket-Sized Performance
All models are priced below \$500. For performance and affordability, nothing will beat a VELOCICHECK from TSI. For more information call 1-800-876-9874.
Ask about our trade-in offer!
One-Day Service Guarantee
TSI Incorporated
P.O. Box 64394 St. Paul, MN 55164

(Circle No. 88 on Reader Service Card)

Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*
 Evaporative cooling for a laboratory facility; Will K. Brown; *September p.60*

Air conditioning

Status of the HVAC industry; Jaroslav Wurm and Richard Biederman; *January p.S23*
 The first 80 years of air conditioning; Bernard A. Nagengast; *January p.S164*
 1992 Technology Awards, HVAC System combines constant air motion and thermal storage; Douglas M. Brant; *March p.21*
 1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; William E. Tinsley, Bryce Swindler and Donald R. Huggins; *March p.24*
 Distributed air conditioning in supermarkets; Dean Calton; *May p.40*
 Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*
 Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*
 Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*

Air distribution

Low temperature air, thermal comfort and indoor air quality; Daniel Int-Hout; *May p.34*
 Distributed air conditioning in supermarkets; Dean Calton; *May p.40*
 Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*
 Cooling our tomorrows economically; John R. Watt; *June p.36*
 An analysis of an evaporative water chiller; Richard G. Supple and Dale R. Broughton; *June p.44*
 Dry climate evaporative cooling with refrigeration backup; C. Mike Scofield and Elia M. Sterling; *June p.49*
 Integrating access floor plenums for HVAC air distribution; Robert W. Shute; *October p.46*

Air flow

1992 Technology Awards, Air handling system retrofit reduces energy consumption; Gerald J. Williams; *March p.34*
 Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loiselle and Richard G. Sextro; *July p.51*
 Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*
 Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*
 HVAC systems for Sakuya Konohanakan; Akira Kato and Kazuhiro Otaka; *August p.37*
 Cool ceiling system; A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*
 Control systems to comply with ASHRAE Standard 62-1989; John I. Levenhagen; *September p.40*
 Ventilation airflow measurement for ASHRAE Standard 62-1989; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*

Freeze-control strategy and air-to-air energy recovery performance; E. G. Phillips, D.R. Fisher, R.E. Chant and B.C. Bradley; *December p.44*

Air handling

1992 Technology Awards, Air handling system retrofit reduces energy consumption; Gerald J. Williams; *March p.34*
 Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*
 Retrofitting the heating system for NASA's Space Shuttle engine test facility; Thomas W. Arceneaux; *July p.24*
 Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*
 Cool ceiling system; A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*
 Ventilation airflow measurement for ASHRAE Standard 62-1989; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*

Air leakage

Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*
 A preview of ASHRAE's revised smoke control manual; John H. Klote; *November p.34*

Air quality

Economizer operation and maintenance for indoor air quality; Joseph A. Ventresca; *January p.26*
 Emerging legal concerns in indoor air quality; Susan L. Rose; *February p.25*
 Doctors, lawyers and building-associated diseases; Michael J. Hodgson and Catherine A. Hess; *February p.25*
 1992 HVAC&R Technology Review, Part II, Indoor air quality and ventilation; M. Bergitta Berglund; *February p.47*
 1992 Technology Awards, HVAC System combines constant air motion and thermal storage; Douglas M. Brant; *March p.21*
 Low temperature air, thermal comfort and indoor air quality; Daniel Int-Hout; *May p.34*
 Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loiselle and Richard G. Sextro; *July p.51*
 Reaching agreements on indoor air quality; Steven M. Stewart; *August p.28*
 Control systems to comply with ASHRAE Standard 62-1989; John I. Levenhagen; *September p.40*
 Commissioning to avoid indoor air quality problems; Elia M. Sterling, Christopher W. Collett, Simon Turner and Christopher C. Downing; *October p.28*
 Ventilation airflow measurement for ASHRAE Standard 62-1989; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*

Ammonia

Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*

Architecture

1992 HVAC&R Technology Review, Part I, Integrating HVAC and architecture; Thomas A. Bathgate; *January p.46*

Balancing

Low temperature air, thermal comfort and indoor air quality; Daniel Int-Hout; *May p.34*

Boiler

1992 Technology Awards, School HVAC renovation provides energy savings; Robert B. Stotz; *March p.30*

Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*

Building systems

Economizer operation and maintenance for indoor air quality; Joseph A. Ventresca; *January p.26*
 1992 HVAC&R Technology Review, Part I, Ensuring safe and healthy buildings; Mal Turaga; *January p.50*
 Emerging legal concerns in indoor air quality; Susan L. Rose; *February p.25*
 Doctors, lawyers and building-associated diseases; Michael J. Hodgson and Catherine A. Hess; *February p.25*
 1992 HVAC&R Technology Review, Part II, HVAC&R and DCS; Fred T. Garrett Jr.; *February p.51*
 1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; William E. Tinsley, Bryce Swindler and Donald R. Huggins; *March p.24*
 Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*
 Reaching agreements on indoor air quality; Steven M. Stewart; *August p.28*
 Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*
 Direct digital control documentation employing graphical programming; Fred G. Davison; *September p.46*
 Integrating building automation and control; William T. Pienta; *September p.54*
 Evaporative cooling for a laboratory facility; Will K. Brown; *September p.60*
 Commissioning; An operation and maintenance perspective; B.T. Tamblin; *October p.22*

Ceiling

Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*
 Cool ceiling system; A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*

Central plant

Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*
 Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*
 Geothermal district heating; A century of service; Kevin Rafferty; *September p.22*

Chiller

Status of the HVAC industry; Jaroslav Wurm and Richard Biederman; *January p.S23*
 Environmental tradeoffs between CFCs and alternative refrigerants; Gary J. Epstein and Steven P. Manwell; *January p.38*
 1992 Technology Awards, School HVAC renovation provides energy savings; Robert B. Stotz; *March p.30*
 Absorption chillers improve cogeneration efficiency; Paul E. Hufford; *March p.46*

Combined chilled water thermal energy storage and fire protection storage systems; Gordon V.R. Holness; *May p.16*

Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*

Keep your cooling tower?; Z. John Zhang; *June p.22*

Retrofitting the heating system for NASA's Space Shuttle engine test facility; Thomas W. Arceneaux; *July p.24*

Cool ceiling system; A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*

Chlorofluorocarbons

Environmental tradeoffs between CFCs and alternative refrigerants; Gary J. Epstein and Steven P. Manwell; *January p.38*

Consultants' options on CFCs and alternative refrigerants, Introduction; James E. Hill; *February p.34*

Consultants' options on CFCs and alternative refrigerants, The CFC phase-out; Issues and problems; Richard C. Barnett; *February p.34*

Consultants' options on CFCs and alternative refrigerants, The impact of EPA's new CFC/HCFC regulations; Robert J. Roth; *February p.35*

Consultants' options on CFCs and alternative refrigerants, Building code recognition of alternative refrigerants; Billy R. Manning; *February p.36*

Consultants' options on CFCs and alternative refrigerants, Retrofitting centrifugal chillers for alternative refrigerants; Richard Ertinger; *February p.38*

Consultants' options on CFCs and alternative refrigerants, Equipment for alternative refrigerants; James M. Calm; *February p.40*

Consultants' options on CFCs and alternative refrigerants, Selecting equipment and refrigerants in uncertain times; William S. Ostrander; *February p.42*

Consultants' options on CFCs and alternative refrigerants, CFC reclaim and disposal; John Grant; *February p.43*

Consultants' options on CFCs and alternative refrigerants, *ASHRAE Standard 15 and Standard 34*; Current and future with new alternative refrigerants; Lee W. Burgett; *February p.44*

1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; Naim Z. Azer; *February p.47*

1992 HVAC&R Technology Review, Part II, ASHRAE—New technologies; William A. Lotz; *February p.48*

1992 HVAC&R Technology Review, Part II, Experience and technical insights in the HVAC&R industry; Richard A. Charles; *February p.48*

1992 HVAC&R Technology Review, Part II, A state of pause...; Alfred E. Guntermann; *February p.49*

1992 HVAC&R Technology Review, Part II, ASHRAE and the future; Richard C. Niess; *February p.49*

Global warming implications of replacing CFCs; Steven K. Fischer, Phillip D. Fairchild and Patrick Hughes; *April p.14*

The CFC controversy; Issues and answers; F. Sherwood Rowland; *December p.20*

Chlorofluorohydrocarbons

The CFC controversy; Issues and answers; F. Sherwood Rowland; *December p.20*

Cogeneration

Absorption chillers improve cogeneration efficiency; Paul E. Hufford; *March p.46*

Coil

Ground-coupled heat pumps for commercial buildings; Steve Kavanaugh; *September p.30*

Comfort

Using laboratory-based models to predict comfort in office buildings; Gail S. Brager; *April p.44*

Low temperature air, thermal comfort and indoor air quality; Daniel Int-Hout; *May p.34*

Integrating access floor plenums for HVAC air distribution; Robert W. Shute; *October p.46*

Commercial

Ground-coupled heat pumps for commercial buildings; Steve Kavanaugh; *September p.30*

Commissioning

Commissioning: An operation and maintenance perspective; B.T. Tamblin; *October p.22*

Commissioning to avoid indoor air quality problems; Elia M. Sterling, Christopher W. Collett, Simon Turner and Christopher C. Downing; *October p.28*

Compressor

1992 HVAC&R Technology Review, Part II, ASHRAE—New technologies; William A. Lotz; *February p.48*

Computer

1992 HVAC&R Technology Review, Part II, Technology and the HVAC designer; J.D. Kern; *February p.52*

Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*

Direct digital control documentation employing graphical programming; Fred G. Davison; *September p.46*

Integrating building automation and control; William T. Pienta; *September p.54*

A preview of ASHRAE's revised smoke control manual; John H. Klote; *November p.34*

Freeze-control strategy and air-to-air energy recovery performance; E. G. Phillips, D.R. Fisher, R.E. Chant and B.C. Bradley; *December p.44*

Condenser

Keep your cooling tower?; Z. John Zhang; *June p.22*

Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*


Condensation

Distributed air conditioning in supermarkets; Dean Calton; *May p.40*

Control

Optimizing water-loop heat pump design and performance; Edward A. Kush and Chester A. Brunner; *February p.14*


The Best Air Curtains on Earth Come from MARS®



Insect Control * Climate Control * Energy Control

MARS AIR DOOR® brand air curtains are your most effective air barrier for complete protection against insects, dust and fumes. Recommended for areas with above normal insect conditions, they are specially engineered for all sizes of warehouse doors...receiving/service doors...refrigerated rooms...customer entrances. Electric, gas & steam heated available.

As an added plus, Mars' air curtains conserve energy by recirculating trapped warm ceiling air down to floor level in cold weather. During warm weather they continually act as a barrier against outside warm air preventing loss of conditioned interior air. Easy-to-install.



Weather, Dust, Insects, Fumes, Pollution and Wind are kept out. Unobstructed view permits free flow of traffic and prevents doorway accidents.



Made in U.S.A.



See us at ASHRAE/ARI Booth #2300

MARS Air Door®

14716 S. Broadway, Gardena, CA 90248
(213) 770-1555 Outside CA (800) 421-1266
FAX (310) 324-3030

(Circle No. 90 on Reader Service Card)

1992 HVAC&R Technology Review, Part II, Trends in environmental controls; Richard M. Kelson; *February p.46*

1992 HVAC&R Technology Review, Part II, ASHRAE—New technologies; William A. Lotz; *February p.48*

1992 HVAC&R Technology Review, Part II, Experience and technical insights in the HVAC&R industry; Richard A. Charles; *February p.48*

1992 HVAC&R Technology Review, Part II, Microelectronics, energy and the environment; Gordon M. Reistad; *February p.51*

1992 HVAC&R Technology Review, Part II, HVAC&R and DCS; Fred T. Garrett Jr.; *February p.51*

1992 HVAC&R Technology Review, Part II, Technical innovations of the future; James E. Hill; *February p.52*

1992 Technology Awards, School HVAC renovation provides energy savings; Robert B. Stotz; *March p.30*

Retrofitting the heating system for NASA's Space Shuttle engine test facility; Thomas W. Arceneaux; *July p.24*

Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*

Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*

Control systems to comply with *ASHRAE Standard 62-1989*; John I. Levenhagen; *September p.40*

Direct digital control documentation employing graphical programming; Fred G. Davison; *September p.46*

Integrating building automation and control; William T. Pienta; *September p.54*

Commissioning: An operation and maintenance perspective; B.T. Tamblin; *October p.22*

Freeze-control strategy and air-to-air energy recovery performance; E. G. Phillips, D.R. Fisher, R.E. Chant and B.C. Bradley; *December p.44*

Contamination

Working with *ANSI/ASHRAE Standard 62-1989*; John E. Janssen; *August p.23*

Reaching agreements on indoor air quality; Steven M. Stewart; *August p.28*

Convection

Cool ceiling system; A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*

Cooling tower

Keep your cooling tower?; Z. John Zhang; *June p.22*

Environmental considerations for cooling towers; Gary R. Mirsky, Jean-Pierre Liebert and Kathy Bryant; *June p.27*

Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*

Dampers

Cooling our tomorrows economically; John R. Watt; *June p.36*

Control systems to comply with *ASHRAE Standard 62-1989*; John I. Levenhagen; *September p.40*

Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*

A preview of ASHRAE's revised smoke control manual; John H. Klote; *November p.34*

Duct protection for variable speed fans; James V. Dirkes II; *November p.40*

Desiccant

1992 HVAC&R Technology Review, Part II, Tomorrow's cooling challenges; John R. Watt; *February p.50*

Distributed air conditioning in supermarkets; Dean Calton; *May p.40*

Cooling our tomorrows economically; John R. Watt; *June p.36*

Duct

Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loisel and Richard G. Sextro; *July p.51*

Integrating access floor plenums for HVAC air distribution; Robert W. Shute; *October p.46*

Duct protection for variable speed fans; James V. Dirkes II; *November p.40*

Calculating for system effect solves fan capacity losses; W. David Bevirt; *November p.46*

Economics

Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*

Environmental considerations for cooling towers; Gary R. Mirsky, Jean-Pierre Liebert and Kathy Bryant; *June p.27*

Cooling our tomorrows economically; John R. Watt; *June p.36*

Education

1992 HVAC&R Technology Review, Part I, Education and innovation; Stanley A. Mumma; *January p.49*

1992 HVAC&R Technology Review, Part I, Ensuring safe and healthy buildings; Mal Turaga; *January p.50*

1992 HVAC&R Technology Review, Part II, Invited opinions about the future; James D. McFall; *February p.46*

1992 HVAC&R Technology Review, Part II, Technical information exchange; Charles J. Procell; *February p.47*

Sharing resources globally; Richard A. Charles; *August p.20*

Electric

1992 HVAC&R Technology Review, Part I, Cooling cycle technologies; Theodore Atwood; *January p.51*

1992 HVAC&R Technology Review, Part I, Electric utility R&D; Maier Perlman; *January p.51*

Energy

Optimizing water-loop heat pump design and performance; Edward A. Kush and Chester A. Brunner; *February p.14*

1992 HVAC&R Technology Review, Part II, A state of pause...; Alfred E. Guntermann; *February p.49*

1992 HVAC&R Technology Review, Part II, Microelectronics, energy and the environment; Gordon M. Reistad; *February p.51*

1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; William E. Tinsley, Bryce Swindler and Donald R. Huggins; *March p.24*

1992 Technology Awards, School HVAC renovation provides energy savings; Robert B. Stotz; *March p.30*

1992 Technology Awards, Air handling system retrofit reduces energy consumption; Gerald J. Williams; *March p.34*

1992 Technology Award; Filtration system solves airborne oil mist problem; Mark O. Witte; *March p.40*

1992 Technology Awards, Geothermal system meets space heating requirements; Larry M. Fettkether; *March p.43*

Global warming implications of replacing CFCs; Steven K. Fischer, Phillip D. Fairchild and Patrick Hughes; *April p.14*

Energy conservation and acceptable indoor air quality; Arthur E. Wheeler; *April p.26*

Working with *ANSI/ASHRAE Standard 62-1989*; John E. Janssen; *August p.23*

Energy calculation

Economizer operation and maintenance for indoor air quality; Joseph A. Ventresca; *January p.26*

1992 HVAC&R Technology Review, Part II, Technical innovations of the future; James E. Hill; *February p.52*

Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*

Energy conservation

Energy conservation and acceptable indoor air quality; Arthur E. Wheeler; *April p.26*

Combined chilled water thermal energy storage and fire protection storage systems; Gordon V.R. Holness; *May p.16*

Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*

Low temperature air, thermal comfort and indoor air quality; Daniel Int-Hout; *May p.34*

Integrating building automation and control; William T. Pienta; *September p.54*

Alternate refrigerants and energy savings in supermarkets; Atma Advani; *December p.40*

Environment

Environmental tradeoffs between CFCs and alternative refrigerants; Gary J. Epstein and Steven P. Maxwell; *January p.38*

1992 HVAC&R Technology Review, Part I, Innovations in the HVAC&R industry; William F. Albern; *January p.46*

1992 HVAC&R Technology Review, Part I, Solving indoor environmental problems; W. David Bevirt; *January p.48*

1992 HVAC&R Technology Review, Part I, Ensuring safe and healthy buildings; Mal Turaga; *January p.50*

1992 HVAC&R Technology Review, Part I, Cooling cycle technologies; Theodore Atwood; *January p.51*

Emerging legal concerns in indoor air quality; Susan L. Rose; *February p.25*

Doctors, lawyers and building-associated dis-

cases; Michael J. Hodgson and Catherine A. Hess; *February p.25*

1992 HVAC&R Technology Review, Part II, Trends in environmental controls; Richard M. Kelso; *February p.46*

1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; Naim Z. Azer; *February p.47*

1992 HVAC&R Technology Review, Part II, A state of pause...; Alfred E. Guntermann; *February p.49*

1992 HVAC&R Technology Review, Part II, ASHRAE and the future; Richard C. Niess; *February p.49*

1992 HVAC&R Technology Review, Part II, HVAC industry at a critical state; Franco Stanzani; *February p.49*

1992 HVAC&R Technology Review, Part II, Perceptions of the HVAC&R industry; David S. Butler Sr.; *February p.50*

1992 HVAC&R Technology Review, Part II, Microelectronics, energy and the environment; Gordon M. Reistad; *February p.51*

Environmental considerations for cooling towers; Gary R. Mirsky, Jean-Pierre Liebert and Kathy Bryant; *June p.27*

Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*

Evaporation

1992 HVAC&R Technology Review, Part II, Tomorrow's cooling challenges; John R.

Watt; *February p.50*

Cooling our tomorrows economically; John R. Watt; *June p.36*

An analysis of an evaporative water chiller; Richard G. Supple and Dale R. Broughton; *June p.44*

Dry climate evaporative cooling with refrigeration backup; C. Mike Scofield and Elia M. Sterling; *June p.49*

Fan

1992 Technology Awards, Air handling system retrofit reduces energy consumption; Gerald J. Williams; *March p.34*

Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*

Calculating for system effect solves fan capacity losses; W. David Bevirt; *November p.46*

Filtration

1992 Technology Award; Filtration system solves airborne oil mist problem; Mark O. Witte; *March p.40*

Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*

Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loiselle and Richard G. Sextro; *July p.51*

Fire safety

Flammability of alternative refrigerants; Robert G. Richard and Ian R. Shankland; *April p.20*

Sandwich pressurization systems for smoke control; Roger Marchant; *November p.20*

Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*

A preview of ASHRAE's revised smoke control manual; John H. Klotz; *November p.34*

Flue gas

Environmental considerations for cooling towers; Gary R. Mirsky, Jean-Pierre Liebert and Kathy Bryant; *June p.27*

Freeze protection

Freeze-control strategy and air-to-air energy recovery performance; E. G. Phillips, D.R. Fisher, R.E. Chant and B.C. Bradley; *December p.44*

Frost

Freeze-control strategy and air-to-air energy recovery performance; E. G. Phillips, D.R. Fisher, R.E. Chant and B.C. Bradley; *December p.44*

Freezing


Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*

Geothermal energy

1992 Technology Awards, Geothermal system meets space heating requirements; Larry M. Fettkether; *March p.43*

Ebac DEHUMIDIFIERS FOR EVERY SITUATION



- Stop dampness from condensation
- Prevent rust and corrosion
- Save on ventilation and heating costs
- Eliminate mold and mildew
- Maintain controlled humidity
- Reduce maintenance costs
- Prevent unpleasant environments

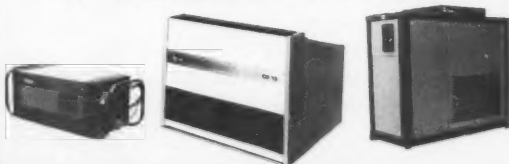

Ebac Systems, Incorporated
106 John Jefferson Road
Suite 102
Williamsburg, Virginia 23185
Telephone (804) 229-3038
Fax (804) 229-3321

(Circle No. 92 on Reader Service Card)

STAINLESS STEEL by Aj REGISTERS & GRILLES

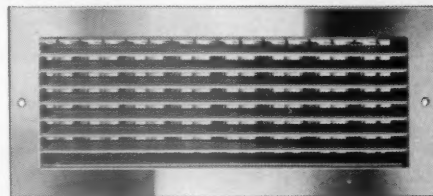

S-44 Stainless OPPOSED BLADE DAMPER

For free catalog contact:
A-J MANUFACTURING CO.
3601 EAST 18th STREET
KANSAS CITY, MO. 64127
Phone (816) 231-5522
Fax 816-231-8437



(Circle No. 94 on Reader Service Card)

1992 Editorial Index

Retrofitting the heating system for NASA's Space Shuttle engine test facility; Thomas W. Arceneaux; *July p.24*

Geothermal district heating: A century of service; Kevin Rafferty; *September p.22*

Greenhouse

Environmental tradeoffs between CFCs and alternative refrigerants; Gary J. Epstein and Steven P. Manwell; *January p.38*

1992 HVAC&R Technology Review, Part II, Tomorrow's cooling challenges; John R. Watt; *February p.50*

Global warming implications of replacing CFCs; Steven K. Fischer, Phillip D. Fairchild and Patrick Hughes; *April p.14*

HVAC systems for Sakuya Konohanakan; Akira Kato and Kazuhiro Otaka; *August p.37*

Health

Doctors, lawyers and building-associated diseases; Michael J. Hodgson and Catherine A. Hess; *February p.25*

1992 HVAC&R Technology Review, Part II, Indoor air quality and ventilation; M. Bergitta Berglund; *February p.47*

1992 HVAC&R Technology Review, Part II, Providing for the health, comfort and welfare of the general public; James E. Woods; *February p.51*

Reaching agreements on indoor air quality; Steven M. Stewart; *August p.28*

Heat exchanger

Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*

Heat pump

Status of the HVAC industry; Jaroslav Wurm and Richard Biederman; *January p.53*

Optimizing water-loop heat pump design and performance; Edward A. Kush and Chester A. Brunner; *February p.14*

A ground-coupled storage heat pump system with waste heat recovery; David C. Drown, Timothy P. Kast and Karen R. Den Braven; *February p.20*

Retrofitting the heating system for NASA's Space Shuttle engine test facility; Thomas W. Arceneaux; *July p.24*

HVAC systems for Sakuya Konohanakan; Akira Kato and Kazuhiro Otaka; *August p.37*

Ground-coupled heat pumps for commercial buildings; Steve Kavanaugh; *September p.30*

Thermoacoustic refrigeration; Steven L. Garrett and Thomas J. Hofler; *December p.28*

Heat recovery

A ground-coupled storage heat pump system with waste heat recovery; David C. Drown, Timothy P. Kast and Karen R. Den Braven; *February p.20*

Absorption chillers improve cogeneration efficiency; Paul E. Hufford; *March p.46*

Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*

HVAC systems for Sakuya Konohanakan; Akira Kato and Kazuhiro Otaka; *August p.37*

Heat transfer

Cooling load calculation: Art or science?; Thomas B. Romine; *January p.14*

1992 HVAC&R Technology Review, Part II, Second generation heat transfer technology; Arthur E. Bergles; *February p.48*

Solid-gas chemisorption: Efficient HVAC&R without CFCs; Uwe Rockenfeller, Lance D. Kirol and William A. Ryan; *March p.54*

Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

Heating

Status of the HVAC industry; Jaroslav Wurm and Richard Biederman; *January p.53*

1992 HVAC&R Technology Review, Part I, Radiant heating technology; Norman A. Buckley; *January p.49*

1992 Technology Awards, Geothermal system meets space heating requirements; Larry M. Fekkether; *March p.43*

Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*

Geothermal district heating: A century of service; Kevin Rafferty; *September p.22*

History


The first 80 years of air conditioning; Bernard A. Nagengast; *January p.5164*

FREE COOLING

WITH THE APV/NORMARK WATER SIDE ECONOMIZER

If year-round cooling is needed to offset heat from computers, electrical equipment or general building heat loads, our Water Side Economizer will save thousands of hours of refrigeration. Using the free cooling available in outside air under optimum wet bulb conditions, this system delivers tower water at a temperature low enough to curtail chiller operation. The key is our efficient plate heat exchanger which provides the needed temperature drop for cooling and simultaneously isolates and protects expensive air conditioning equipment from tower water contamination. Payback can be as little as 18 months.

Other energy saving HVAC systems are detailed in our new HVAC plate heat exchanger bulletin. Ask for a copy and then call one of our experts to help you cut cooling and heating costs.



APV Crepaco Inc
395 Fillmore Ave., Tonawanda, NY 14150
phone: (716) 692-3000

(Circle No. 96 on Reader Service Card)

FREE!

1993 NEW

CATALOG

CONTROLS
AND
GAGES



Over 1500 pressure, flow, level and temperature controls described with technical and application information. A must for all engineers and designers. Includes prices. Industry's indispensable source guide to Dwyer, Mercoid, W.E. Anderson, Proximity and Love product lines.



DWYER INSTRUMENTS, INC.
P.O. Box 373, Michigan City, IN 46360
Phone 219-879-8000 FAX 219-872-9057

(Circle No. 98 on Reader Service Card)

1992 HVAC&R Technology Review, Part I, Innovations in the HVAC&R industry; William F. Albern; *January p.46*

1992 HVAC&R Technology Review, Part I, The challenge is us; Richard E. Dussault; *January p.53*

Hot water

Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*

Human factors

Emerging legal concerns in indoor air quality; Susan L. Rose; *February p.25*

Doctors, lawyers and building-associated diseases; Michael J. Hodgson and Catherine A. Hess; *February p.25*

Humidification

Dry climate evaporative cooling with refrigeration backup; C. Mike Scofield and Elia M. Sterling; *June p.49*

Humidity

1992 Technology Awards, HVAC System combines constant air motion and thermal storage; Douglas M. Brant; *March p.21*

1992 Technology Award; Filtration system solves airborne oil mist problem; Mark O. Witte; *March p.40*

Working with ANSI/ASHRAE Standard 62-1989; John E. Janssen; *August p.23*

Cool ceiling system: A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*

Ice

Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*

Laboratory

Using laboratory-based models to predict comfort in office buildings; Gail S. Brager; *April p.44*

Evaporative cooling for a laboratory facility; Will K. Brown; *September p.60*

Leakage

Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loiselle and Richard G. Sextro; *July p.51*

Load calculation

Cooling load calculation: Art or science?; Thomas B. Romine Jr.; *January p.14*

1992 Technology Awards, School HVAC renovation provides energy savings; Robert B. Stotz; *March p.30*

Energy conservation and acceptable indoor air quality; Arthur E. Wheeler; *April p.26*

Low temperature

Low temperature air, thermal comfort and indoor air quality; Daniel Int-Hout; *May p.34*

Maintenance

1992 Technology Awards, Rooftop HVAC system offers optimum energy efficiency; William E. Tinsley, Bryce Swindler and Donald R. Huggins; *March p.24*

Reaching agreements on indoor air quality; Steven M. Stewart; *August p.28*

Commissioning: An operation and maintenance perspective; B.T. Tamblin; *October p.22*

Measurement

Ventilation airflow measurement for ASHRAE Standard 62-1989; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*

Microbiology

Doctors, lawyers and building-associated diseases; Michael J. Hodgson and Catherine A. Hess; *February p.25*

An analysis of an evaporative water chiller; Richard G. Supple and Dale R. Broughton; *June p.44*

Working with ANSI/ASHRAE Standard 62-1989; John E. Janssen; *August p.23*

Reaching agreements on indoor air quality; Steve M. Stewart; *August p.28*

Modeling

Using laboratory-based models to predict comfort in office buildings; Gail S. Brager; *April p.44*

Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

Ventilation airflow measurement for ASHRAE Standard 62-1989; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*

Monitoring

Commissioning: An operation and maintenance perspective; B.T. Tamblin; *October p.22*

Commissioning to avoid indoor air quality problems; Elia M. Sterling, Christopher W. Collett, Simon Turner and Christopher C. Downing; *October p.28*

Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*

The CFC controversy: Issues and answers; F. Sherwood Rowland; *December p.20*

Moisture

Distributed air conditioning in supermarkets; Dean Calton; *May p.40*

Noise

Environmental considerations for cooling towers; Gary R. Mirsky, Jean-Pierre Liebert and Kathy Bryant; *June p.27*

Odor

Working with ANSI/ASHRAE Standard 62-1989; John E. Janssen; *August p.23*

Piping

Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*

Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*

Cool ceiling system: A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*

Geothermal district heating: A century of service; Kevin Rafferty; *September p.22*

Ground-coupled heat pumps for commercial buildings; Steve Kavanaugh; *September p.30*

Pressure

Sandwich pressurization systems for smoke control; Roger Marchant; *November p.20*

Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*

A preview of ASHRAE's revised smoke control manual; John H. Klotz; *November p.34*

Duct protection for variable speed fans; James V. Dirkes II; *November p.40*

Calculating for system effect solves fan capacity losses; W. David Bevitt; *November p.46*

Pumps

Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*

Keep your cooling tower?; Z. John Zhang; *June p.22*

Cooling our tomorrows economically; John R. Watt; *June p.36*

Retrofitting the heating system for NASA's Space Shuttle engine test facility; Thomas W. Arceneaux; *July p.24*

Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*

Air-conditioning system retrofit for an historic office building; Dennis J. Wessel; *July p.38*

Geothermal district heating: A century of service; Kevin Rafferty; *September p.22*

Ground-coupled heat pumps for commercial buildings; Steve Kavanaugh; *September p.30*

Radiant

Cooling load calculation: Art or science?; Thomas B. Romine Jr.; *January p.14*

1992 HVAC&R Technology Review, Part I, Radiant heating technology; Norman A. Buckley; *January p.49*

Radiation

Cool ceiling system: A European air-conditioning alternative; Christopher K. Wilkins and Risto Kosonen; *August p.41*

The CFC controversy: Issues and answers; F. Sherwood Rowland; *December p.20*

Recovery

Consultants' options on CFCs and alternative refrigerants, CFC reclaim and disposal; John Grant; *February p.43*

1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; Naim Z. Azer; *February p.47*

Recycling

Consultants' options on CFCs and alternative refrigerants, CFC reclaim and disposal; John Grant; *February p.43*

1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; Naim Z. Azer; *February p.47*

Refrigerant

Environmental tradeoffs between CFCs and alternative refrigerants; Gary J. Epstein and Steven P. Maxwell; *January p.38*

1992 HVAC&R Technology Review, Part I, Cooling cycle technologies; Theodore Atwood; *January p.51*

Consultants' options on CFCs and alternative refrigerants, Introduction; James E. Hill; *February p.34*

Consultants' options on CFCs and alternative refrigerants, The CFC phase-out: Issues and problems; Richard C. Barnett; *February p.34*

Consultants' options on CFCs and alternative refrigerants, The impact of EPA's new CFC/HCFC regulations; Robert J. Roth; *February p.35*

1992 Editorial Index

- Consultants' options on CFCs and alternative refrigerants, Building code recognition of alternative refrigerants; Billy R. Manning; *February p.36*
- Consultants' options on CFCs and alternative refrigerants, Retrofitting centrifugal chillers for alternative refrigerants; Richard Ertinger; *February p.38*
- Consultants' options on CFCs and alternative refrigerants, Equipment for alternative refrigerants; James M. Calm; *February p.40*
- Consultants' options on CFCs and alternative refrigerants, Selecting equipment and refrigerants in uncertain times; William S. Ostrander; *February p.42*
- Consultants' options on CFCs and alternative refrigerants, CFC reclaim and disposal; John Grant; *February p.43*
- Consultants' options on CFCs and alternative refrigerants, *ASHRAE Standard 15* and *Standard 34*: Current and future with new alternative refrigerants; Lee W. Burgett; *February p.44*
- 1992 HVAC&R Technology Review, Part II, Recycling and recovery of CFCs; Naim Z. Azer; *February p.47*
- Global warming implications of replacing CFCs; Steven K. Fischer, Phillip D. Fairchild and Patrick Hughes; *April p.14*
- Flammability of alternative refrigerants; Robert G. Richard and Ian R. Shankland; *April p.20*
- Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*
- Alternate refrigerants and energy savings in supermarkets; Atma Advani; *December p.40*
- Refrigeration**
- Modernizing and retrofitting ice skating rinks; Russell W. Blades; *April p.34*
- Dry climate evaporative cooling with refrigeration backup; C. Mike Scofield and Elia M. Sterling; *June p.49*
- Thermoacoustic refrigeration; Steven L. Garrett and Thomas J. Hoffer; *December p.28*
- Alternate refrigerants and energy savings in supermarkets; Atma Advani; *December p.40*
- Refrigerator**
- Thermoacoustic refrigeration; Steven L. Garrett and Thomas J. Hoffer; *December p.28*
- Research**
- 1992 HVAC&R Technology Review, Part I, Electric utility R&D; Maier Perlman; *January p.51*
- Commissioning: An operation and maintenance perspective; B.T. Tamblin; *October p.22*
- Commissioning to avoid indoor air quality problems; Elia M. Sterling, Christopher W. Collett, Simon Turner and Christopher C. Downing; *October p.28*
- Research report**
- Using laboratory-based models to predict comfort in office buildings; Gail S. Brager; *April p.44*
- Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*
- Performance of air cleaners in a residential forced air system; Francis J. Offermann, Steven A. Loiseau and Richard G. Sextro; *July p.51*
- Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*
- Alternate refrigerants and energy savings in supermarkets; Atma Advani; *December p.40*
- Residential**
- Working with *ANSI/ASHRAE Standard 62-1989*; John E. Janssen; *August p.23*
- Safety**
- Flammability of alternative refrigerants; Robert G. Richard and Ian R. Shankland; *April p.20*
- School**
- Energy conservation and acceptable indoor air quality; Arthur E. Wheeler; *April p.26*
- Sensor**
- Ventilation airflow measurement for *ASHRAE Standard 62-1989*; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*
- Smoke control**
- Sandwich pressurization systems for smoke control; Roger Marchant; *November p.20*
- Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*
- A preview of ASHRAE's revised smoke control manual; John H. Klotz; *November p.34*
- Solar**
- Cooling load calculation: Art or science?; Thomas B. Romine Jr.; *January p.14*
- Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*
- Sorption**
- Solid-gas chemisorption: Efficient HVAC&R without CFCs; Uwe Rockenfeller, Lance D. Kirol and William A. Ryan; *March p.54*
- Space heating**
- 1992 Technology Awards, Geothermal system meets space heating requirements; Larry M. Fettkether; *March p.43*
- Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*
- Standards**
- Consultants' options on CFCs and alternative refrigerants, *ASHRAE Standard 15* and *Standard 34*: Current and future with new alternative refrigerants; Lee W. Burgett; *February p.44*
- 1992 HVAC&R Technology Review, Part II, Perceptions of the HVAC&R industry; David S. Butler Sr.; *February p.50*
- 1992 HVAC&R Technology Review, Part II, Providing for the health, comfort and welfare of the general public; James E. Woods; *February p.51*
- Energy conservation and acceptable indoor air quality; Arthur E. Wheeler; *April p.26*
- Using laboratory-based models to predict comfort in office buildings; Gail S. Brager; *April p.44*
- Working with *ANSI/ASHRAE Standard 62-1989*; John E. Janssen; *August p.23*
- Control systems to comply with *ASHRAE Standard 62-1989*; John I. Levenhagen; *September p.40*
- Steam**
- Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*
- HVAC systems for Sakuya Konohanakan; Akira Kato and Kazuhiro Otake; *August p.37*
- Supermarket**
- Distributed air conditioning in supermarkets; Dean Calton; *May p.40*
- Alternate refrigerants and energy savings in supermarkets; Atma Advani; *December p.40*
- Testing**
- Flammability of alternative refrigerants; Robert G. Richard and Ian R. Shankland; *April p.20*
- Using laboratory-based models to predict comfort in office buildings; Gail S. Brager; *April p.44*
- Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*
- Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*
- A preview of ASHRAE's revised smoke control manual; John H. Klotz; *November p.34*
- Calculating for system effect solves fan capacity losses; W. David Bevirt; *November p.46*
- Alternate refrigerants and energy savings in supermarkets; Atma Advani; *December p.40*
- Thermal response**
- Evaporative cooling for a laboratory facility; Will K. Brown; *September p.60*
- Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*
- Thermal storage**
- Combined chilled water thermal energy storage and fire protection storage systems; Gordon V.R. Holness; *May p.16*
- Central solar heating plants with seasonal storage; Dwayne S. Breger, Charles A. Bankston and J. Edward Sunderland; *May p.27*
- Integrating access floor plenums for HVAC air distribution; Robert W. Shute; *October p.46*
- Thermoacoustic**
- Thermoacoustic refrigeration; Steven L. Garrett and Thomas J. Hoffer; *December p.28*
- Thermodynamic**
- Thermoacoustic refrigeration; Steven L. Garrett and Thomas J. Hoffer; *December p.28*
- Thermography**
- Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*
- Utility**
- 1992 HVAC&R Technology Review, Part I, Electric utility R&D; Maier Perlman; *January p.51*

Vapor compression

Solid-gas chemisorption: Efficient HVAC&R without CFCs; Uwe Rockenfeller, Lance D. Kirol and William A. Ryan; *March p.54*

Variable volume

Economizer operation and maintenance for indoor air quality; Joseph A. Ventresca; *January p.26*

Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*

Air-conditioning systems of the KI Building; Akira Okamoto, Toshio Hasegawa and Satoshi Togari; *August p.33*

Control systems to comply with *ASHRAE Standard 62-1989*; John I. Levenhagen; *September p.40*

Duct protection for variable speed fans; James V. Dirkes II; *November p.40*

Ventilation

Economizer operation and maintenance for indoor air quality; Joseph A. Ventresca; *January p.26*

Status of the HVAC industry; Jaroslav Wurm and Richard Biederman; *January p.523*

1992 HVAC&R Technology Review, Part I, Solving indoor environmental problems; W. David Bevitt; *January p.48*

Doctors, lawyers and building-associated diseases; Michael J. Hodgson and Catherine A. Hess; *February p.25*

1992 HVAC&R Technology Review, Part II, Indoor air quality and ventilation; M. Bergitta Berglund; *February p.47*

1992 Technology Awards, HVAC System combines constant air motion and thermal storage; Douglas M. Brant; *March p.21*

Energy conservation and acceptable indoor air quality; Arthur E. Wheeler; *April p.26*

Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*

Estimating the indoor air quality and energy performance of VAV systems; Harry J. Sauer Jr. and Ronald H. Howell; *July p.43*

Working with *ANSI/ASHRAE Standard 62-1989*; John E. Janssen; *August p.23*

HVAC systems for Sakuya Konohanakan; Akira Kato and Kazuhiro Otake; *August p.37*

Control systems to comply with *ASHRAE Standard 62-1989*; John I. Levenhagen; *September p.40*

Ventilation airflow measurement for *ASHRAE Standard 62-1989*; Kirk H. Drees, Jarrell D. Wenger and George Janu; *October p.40*

Sandwich pressurization systems for smoke control; Roger Marchant; *November p.20*

Testing and certification of fire and smoke dampers; J.S. Parikh; *November p.30*

A preview of ASHRAE's revised smoke control manual; John H. Klote; *November p.34*

Calculating for system effect solves fan capacity losses; W. David Bevitt; *November p.46*

Vibration

Economizer operation and maintenance for indoor air quality; Joseph A. Ventresca; *January p.26*

Providing a healthy environment at the Marine Mammal Pavilion; William A. DeLoache; *May p.48*

Water treatment

Combined chilled water thermal energy storage and fire protection storage systems; Gordon V.R. Holness; *May p.16*

Environmental considerations for cooling towers; Gary R. Mirsky, Jean-Pierre Liebert and Kathy Bryant; *June p.27*

An analysis of an evaporative water chiller; Richard G. Supple and Dale R. Broughton; *June p.44*


Renovating the Pentagon's heating and refrigeration plant; Gerald C. Snyder Jr.; *July p.28*

Window

Using infrared thermography to study building heat transfer; D.K. Arasteh, F.A. Beck, B.T. Griffin, N. Byars and M. Acevedo-Ruiz; *October p.34*


ROOF TOP AIR HANDLERS

Direct Expansion or Chilled Water

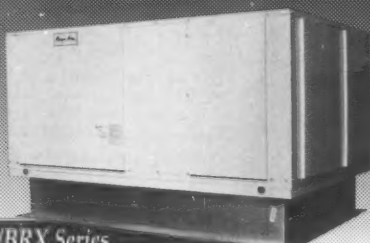


BRW/BRX Series

- Nominal sizes 2 through 10 tons. Available from stock.
- Contact factory for 15 & 20 ton unit availability.
- 3 row DX coils, 4 & 6 row cooling coils. Available from stock.
- Stocked down discharge. Horizontal discharge available.
- Optional accessories:
Hot water coils, steam coils, factory wired economizer,
0 to 100% outside air dampers, roof curbs,
various motors and drive combinations



Magic Aire

DIVISION UNITED ELECTRIC CO.
COIL AND AIR HANDLING PRODUCTS



P. O. Box 5148 • Wichita Falls, Texas 76707 • (817) 767-8333 • FAX (817) 766-3240

RUN ON IBM PC, XT, AT, 386, & IBM COMPATIBLES

DOE-2.1 D ON MICRO

Believe it or not, MICRO-DOE2 takes less than a minute per zone to run an annual hour- by-hour Building Energy Simulation (from Load Calculation and Equipment Sizing to Economic Analyses), when run on a fast 386 PC.

- Simulate **20+** HVAC Systems
- Generate **60+** Standard Reports, plus user defined Hourly Reports
- Save **\$100+** Per Run for a 20-zone building annual simulation (vs. mainframe run)
- Save **\$1,000+** Per Year (easily) on building energy consumption (vs. design without What-If-study)
- **MICRO-DOE2** is an enhanced, full-featured micro-computer version of the mainframe DOE-2 program developed by the U.S. Department of Energy.
- A **Special Version** for 386 PCs is available now. System Requirements: 3 MB of RAM and a 30387 or Weitek coprocessor.
- **MICRO-DOE2**, in use since **February 1987**, has a proven track record of **Reliability and Support**.

For more information, please call or write:

ACROSFT INTERNATIONAL INC.®

9745 E. Hampden Ave., Suite #230
Denver, Colorado 80231
Tel: (303) 368-9225, Fax: (303) 368-5929

Engineering/Financial Custom Programming Welcomed.